




INSTALLATION, OPERATION AND MAINTENANCE INSTRUCTIONS FOR INDEECO RELAY KIT FOR COMMERCIAL UNIT HEATER "UCI SERIES"

CAUTION

***DISCONNECT ALL POWER SUPPLIES
BEFORE WORKING ON ANY CIRCUIT.***

1. Remove access control box cover of the heater.
2. Position the relay in the control box and secure it with the screws provided.
3. Connect low voltage thermostat to small gauge red and white relay wires.

4. Make the following connections :
(see wiring diagram on the access control box cover)
Red ▶ T1
Black ▶ T2
Blue ▶ R1 (if necessary)
5. Secure access control box cover and re-energize
6. Check relay by temporarily setting thermostat to maximum temperature. Reset thermostat to the desired set point when the test is completed.

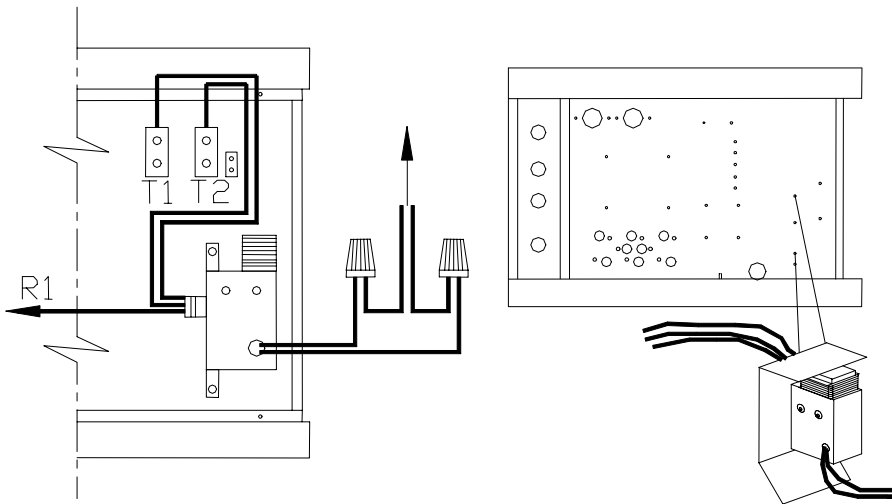

INDEECO
425 Hanley Industrial Court
St. Louis, MO 63144
Phone: (314) 644-4300 Fax: (314) 644-5332
www.indeeco.com